

ALN-V PHOTOELECTRIC SMOKE SENSOR



Shown without base

STANDARD FEATURES

- Low profile - Only 2.00" high, including base
- Simple and reliable device addressing
- Automatic compensation for sensor contamination
- Built-in fire test feature
- Uses the noise-immune Digital Communication Protocol (DCP), which utilizes interrupts for fast response to fires
- Two built-in power/alarm LEDs
- Programmable non-polling LEDs
- Non-directional smoke chamber
- Vandal resistant security locking feature
- Removable smoke labyrinth for cleaning or replacement

SPECIFICATIONS

Operating Voltage	17-41 VDC
Standby Current	450µA
Alarm Current	540µA
Transmission Method	DCP - <i>Digital Communication Protocol</i>
Maximum Humidity	95% RH Non-Condensing
UL Temperature Range	32°F to 115° F (0° C to 47° C)
Operating Temperature Range	14°F to 122° F (-10° C to 50° C)
Sensitivity Range	0.7 - 4.0%/FT @300FPM 0.7 - 3.86%/FT @2000FPM 0.7 - 2.65%/FT @4000FPM
Air Velocity Range	0-4000 fpm
Color & Case Material	Bone / White - ABS Blend
Weight	3.4oz (5.1 oz. with 4" base)
Bases	YBN-NSA-4, HSB-NSA-6, ASB, SCI-B4 and SCI-B6

APPLICATION

The Hochiki America ALN-V Photoelectric Smoke Sensor is particularly suited to detecting optically dense smoke typical of fires involving materials such as soft furnishings, plastic, foam or other similar materials which tend to smolder and produce large visible smoke particles. Hochiki's unique design allows fast response to flaming fires as well as smoldering fires while preventing false alarms.

OPERATION

The detection chamber consists of a light-emitting diode (LED) and photodiode arrangement. The chamber is designed such that light emitted by the LED cannot normally reach the photo diode. In the event of fire, particles of smoke enter the chamber and scatter the light. As the smoke level increases, the scattering effect increases, causing more light to hit the photodiode. The chamber contains a unique baffle design which allows smoke to enter the chamber while preventing external light from affecting the photodiode. The photodiode input level is sampled to sense smoke density.




When the smoke density exceeds a preset threshold the sensor transmits an interrupt to the fire control panel indicating a fire condition. The fire alarm control panel can adjust the sensor threshold to compensate for contamination.

Up to 127 devices are permitted on each SLC loop. A sensor address is set by a hand-held programming unit. The sensor mounts to an electronics-free base and incorporates a locking mechanism for secure installation. The base provides mounting slots, terminals for field wiring and a third contact for a remote indicator/LED. The sensor incorporates dual LEDs for easy viewing of sensor status.

ENGINEERING SPECIFICATIONS

The contractor shall furnish and install where indicated on the plans, photoelectric sensors Hochiki America Model ALN-V. The combination sensor head and twist lock base shall be UL listed compatible with a UL listed fire alarm control panel.

PRODUCT LISTINGS

			California
			State Fire Marshal
			7272-0410:0204

Continued on back.

Hochiki America Corporation

7051 Village Drive, Suite 100 Buena Park, CA 90621-2268
 Phone: 714/522-2246 Fax: 714/522-2268
 Technical Support: 800/845-6692 or technicalsupport@hochiki.com



Find latest revision at www.hochiki.com

ENGINEERING SPECIFICATIONS *(continued)*


The base shall permit direct interchange with the Hochiki America AIE-EA ionization type smoke sensor, ALG-V, ALK-V/ALK-V2 Photoelectric type smoke sensors, ATG-EA, ATJ-EA Heat sensors and the ACA-V, ACC-V Multi-Criteria sensors.

The sensitivity of the sensor shall be capable of being measured by the control panel.


The vandal-resistant, security locking feature shall be used in those areas as indicated on the drawing. The locking feature shall be optional and can be implemented when required.

BASES

The Hochiki America HSB-NSA-6 and the YBN-NSA-4 mounting bases are electronics free and are a simple rugged design with screw terminals for wiring connections. A common mounting base allows sensor interchange and maintains loop continuity when sensors are removed. A simple anti-tamper head locking system is provided which is enabled by removing a small plastic tab on the back of the sensor. Once locked, the head can be removed using a small diameter screwdriver.

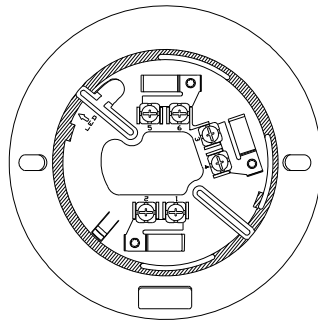


HSB-NSA-6 Base



YBN-NSA-4 Base

TYPICAL WIRING DIAGRAMS

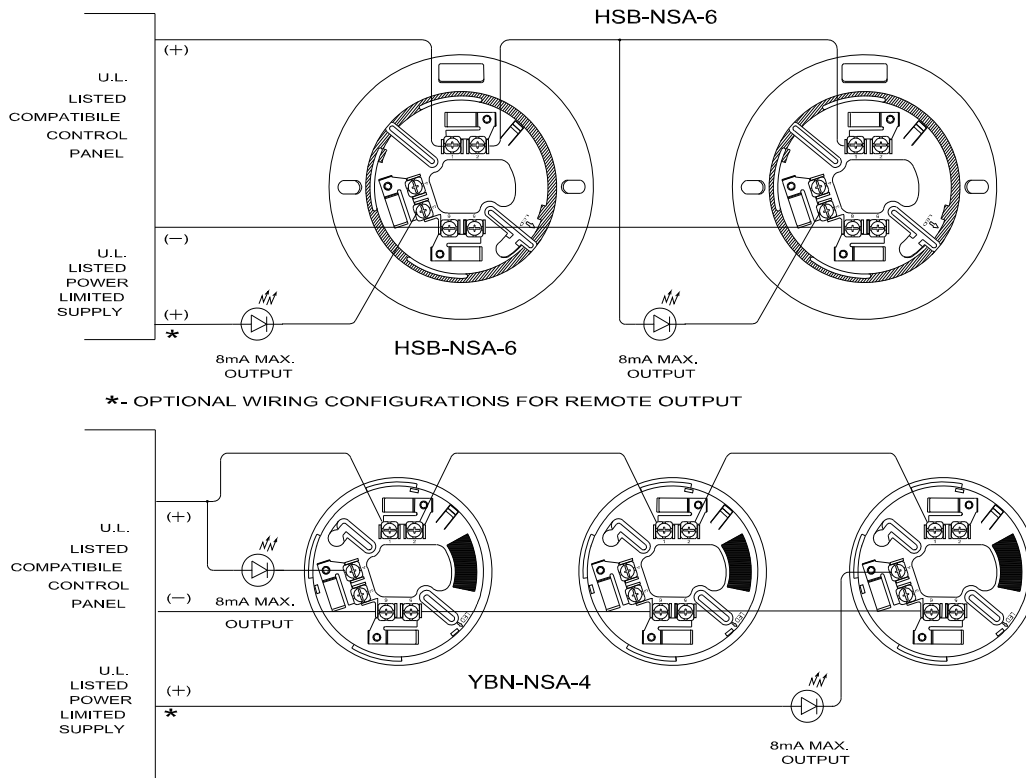

NOTE: Fire alarm control panel compatibility is required for DCP products.

DCP communications protocol allows system components (DCP sensors AIE-EA, ALG-V, ACA-V, ACC-V, ALK-V, ATJ-EA and ATG-EA, bases and modules) to be used concurrently on a system's SLC (Signaling Line Circuit).